
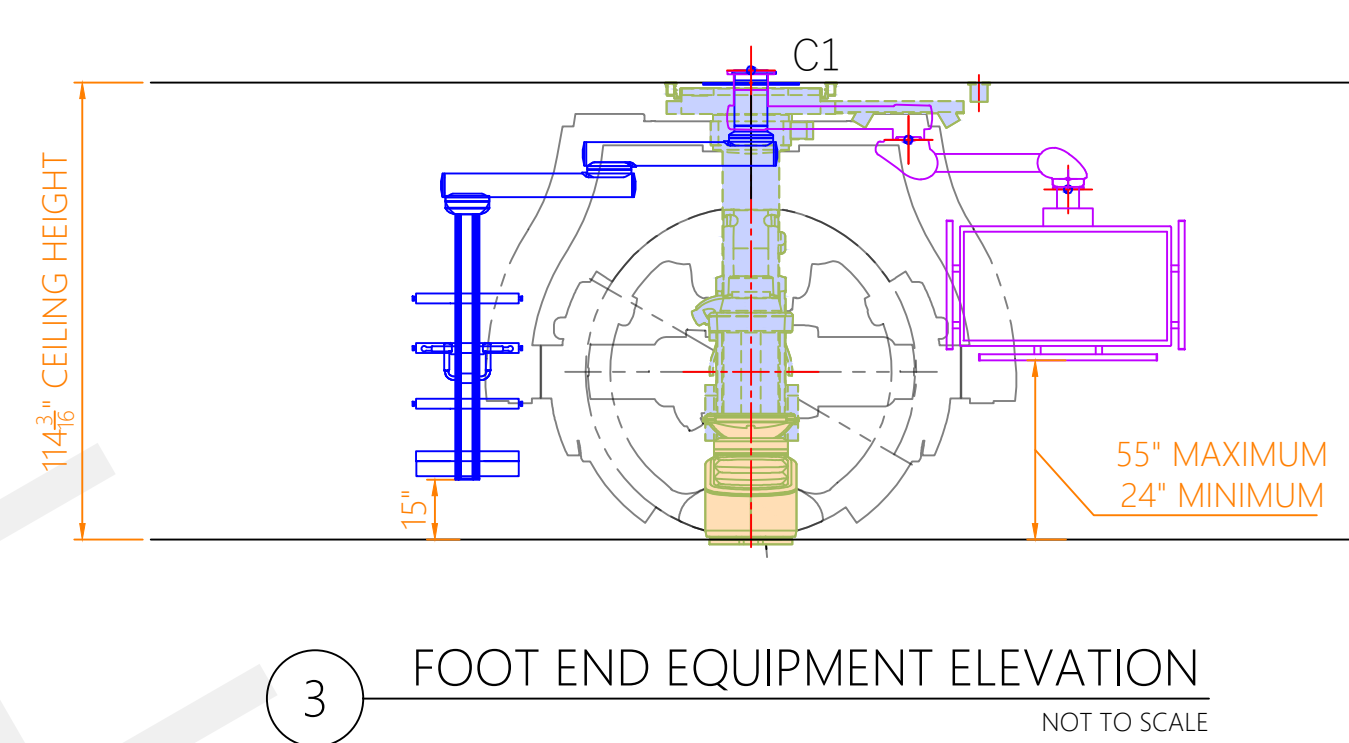
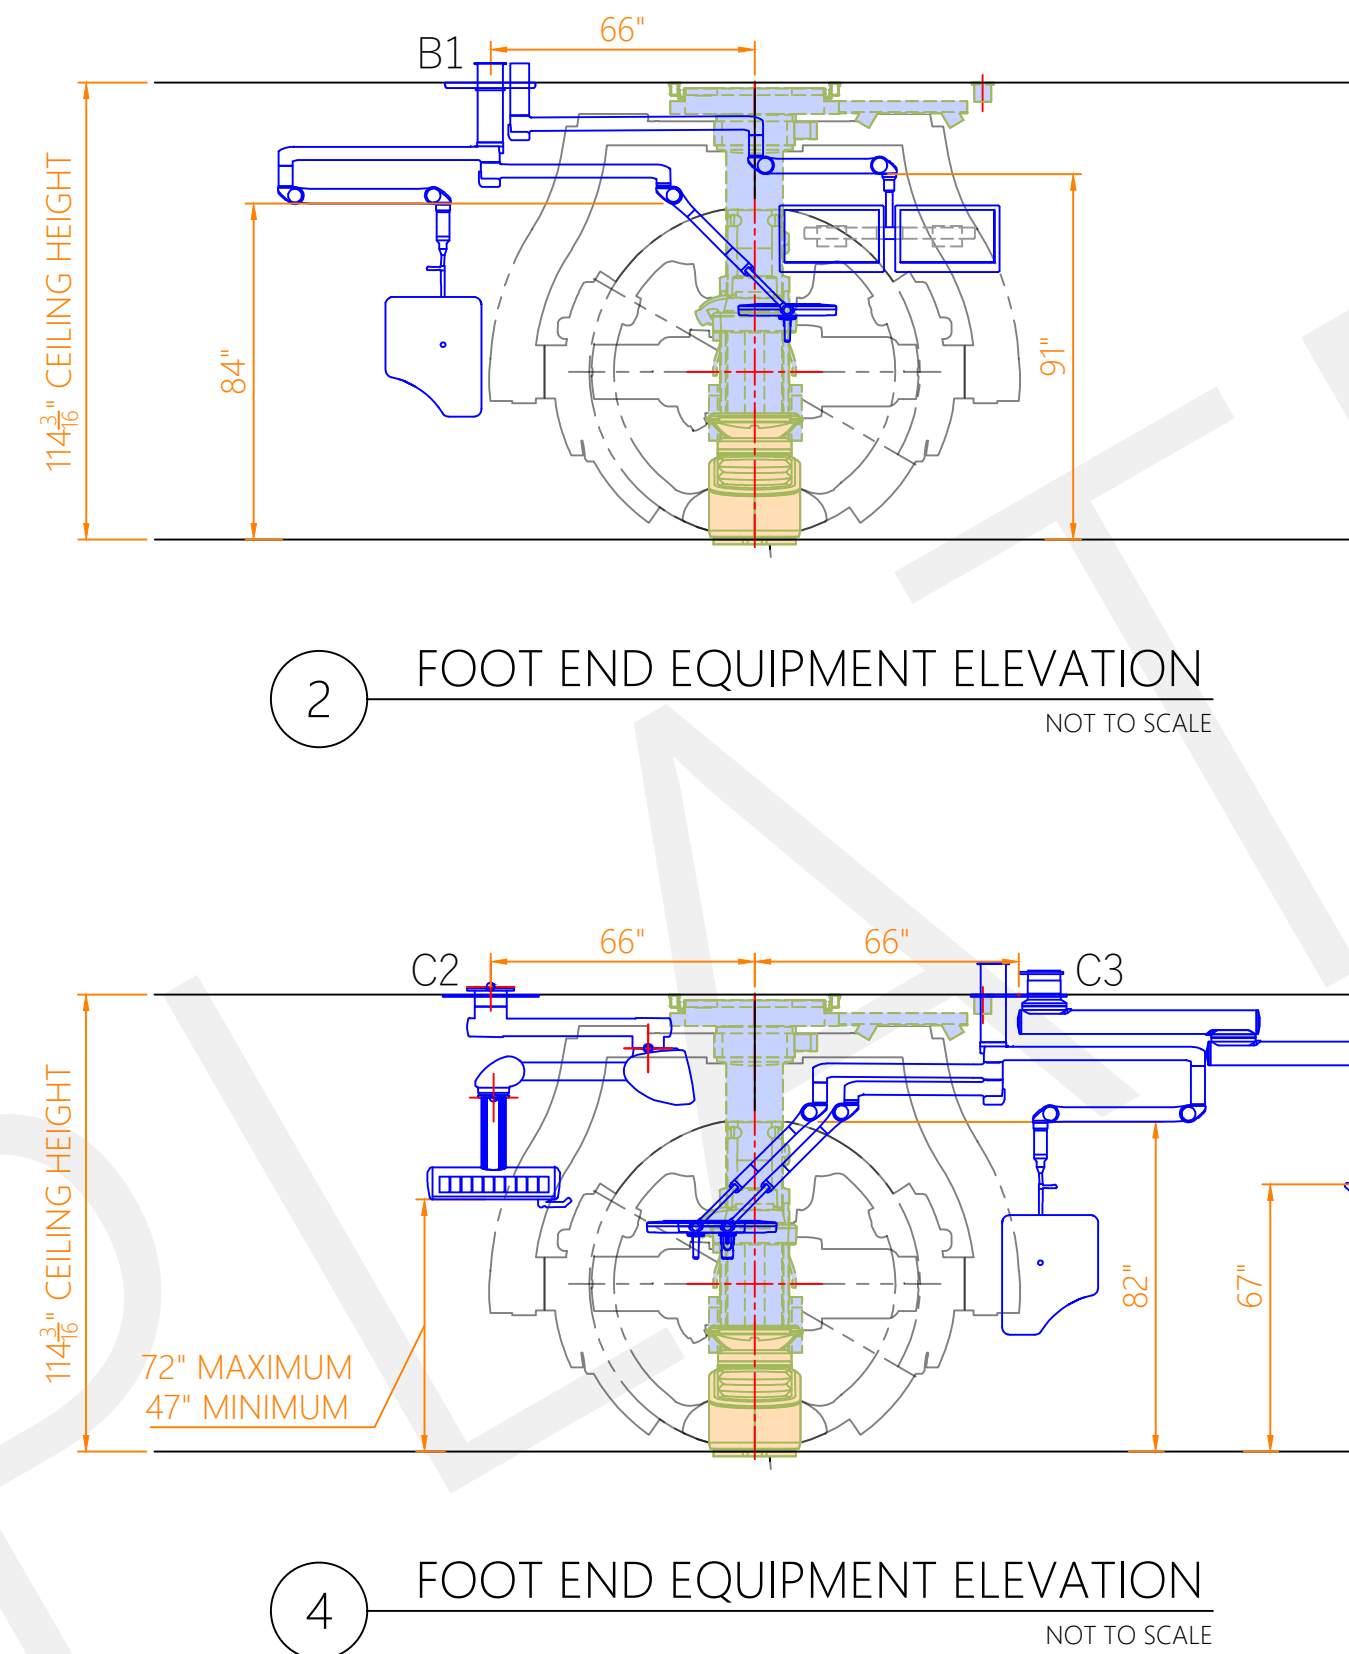


STERIS drawings do not supersede the drawings from the architect of record.

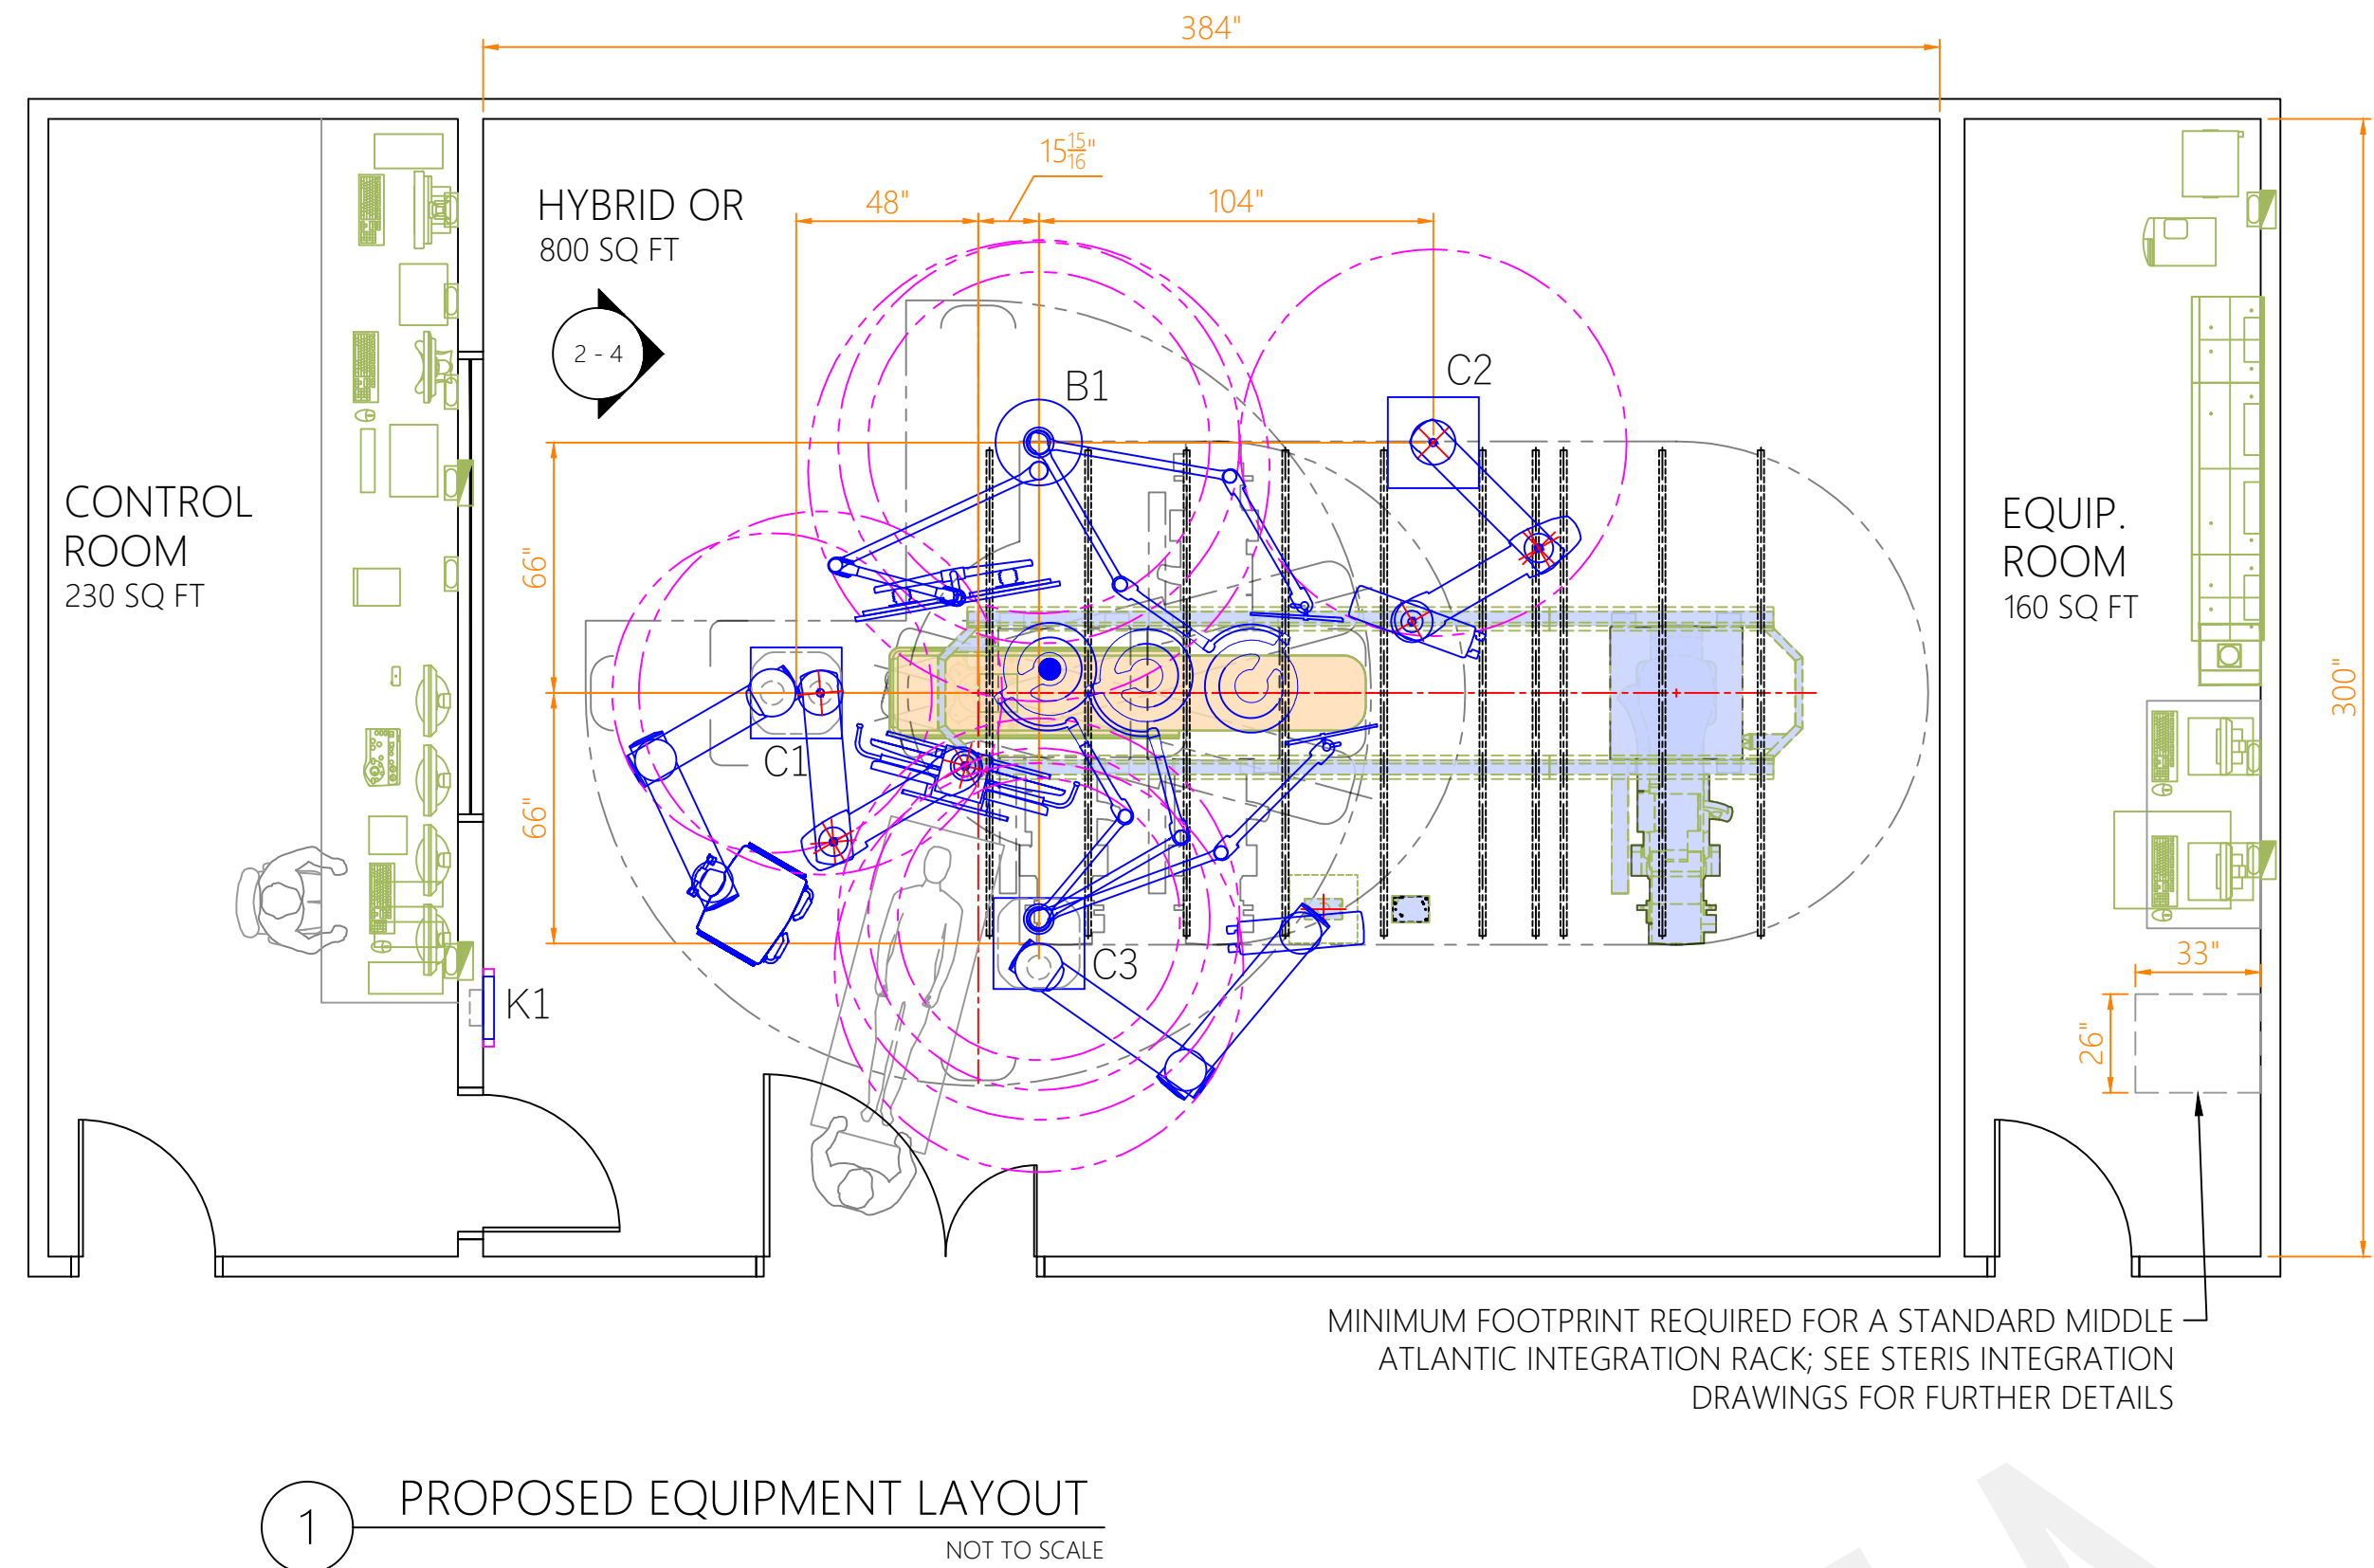

| EQUIPMENT LIST | | |
|----------------|-----|---|
| TAG | QTY | DESCRIPTION |
| B1 | 1 | A Series-Accessory Arm(s), Surgical Light(s) & Accessory Arm(s) |
| C1 | 1 | Tandem HarmonyAIR Adj Arm Monitor Carrier - HarmonyAIR Fixed-Equipment, Monitor Carrier |
| C2 | 1 | HarmonyAIR Adj Arm, Motor Supply Head-Anesthesia |
| C3 | 1 | Tandem HarmonyAIR Fixed - A Series-Perfusionist, Surgical Light(s) & Accessory Arm(s) |
| K1 | 1 | HarmonyAIR A-Series Integrated Wall Control |

| A SERIES LIGHT CONDUIT SCHEDULE | | | |
|---------------------------------|--|------|-----------------------|
| FROM - TO | QUANTITY | SIZE | RESPONSIBILITY |
| K1 - C3 | 2 | .75" | ELECTRICAL CONTRACTOR |
| K1 - B1 | 1 | .75" | ELECTRICAL CONTRACTOR |
| C3 - B1 | CONNECTED VIA FLEX CONDUIT INCLUDED IN SPLIT MOUNT KIT | | |

LIGHT CONDUIT SCHEDULE NOTES
1. 3" CONDUIT FOR AC POWER TO K1; 3 COND. 10AWG WIRE INPUT AC SUPPLY
2. 120V-240VAC, 7A-3A, 50/60Hz
2. LIGHTING CONDUIT RUNS NOT TO EXCEED 25 FEET
3. CONDUIT REQUIREMENTS FOR LIGHTS ALSO REFERENCED WITHIN THE EQUIPMENT DRAWINGS FOR THE SPECIFIED SURGICAL LIGHT WALL CONTROL SYSTEM
4. DC SUPPLY LIGHTHEAD CABLES REQUIRE 1" CONDUIT WHEN DOUBLE RUNS ARE REQUIRED (LONG RUNS)
5. REFER TO APPROPRIATE EQUIPMENT SPECIFICATIONS TO ENSURE THAT THE MOST CURRENT & DETAILED INFORMATION OF THIS LIGHT SYSTEM IS UTILIZED

THIS LAYOUT IS INTENDED TO ENCOURAGE DISCUSSIONS FOR AN INTEGRATED DESIGN PROCESS.
FOR AN OPTIMIZED OPERATING ROOM DESIGN SOLUTION, PLEASE CONTACT YOUR LOCAL STERIS REPRESENTATIVE.
REFER TO THE IMAGING VENDOR FOR ALL IMAGING SYSTEM DIMENSIONS, LOCATIONS, AND REQUIREMENTS.

STERIS drawings do not supersede the drawings from the architect of record.